



DEPARTMENT OF REGULATORY AND ECONOMIC RESOURCES (RER)
BOARD AND CODE ADMINISTRATION DIVISION

MIAMI-DADE COUNTY
PRODUCT CONTROL SECTION
11805 SW 26 Street, Room 208
Miami, Florida 33175-2474
T (786) 315-2590 F (786) 315-2599
www.miamidade.gov/economy

NOTICE OF ACCEPTANCE (NOA)

Best Metal Roofing & Custom Sheet Metal, LLC
849 SW 69 Ave.
Miami, FL 33144

SCOPE:

This NOA is being issued under the applicable rules and regulations governing the use of construction materials. The documentation submitted has been reviewed and accepted by Miami-Dade County RER - Product Control Section to be used in Miami-Dade County and other areas where allowed by the Authority Having Jurisdiction (AHJ).

This NOA shall not be valid after the expiration date stated below. The Miami-Dade County Product Control Section (in Miami-Dade County) and/or the AHJ (in areas other than Miami-Dade County) reserve the right to have this product or material tested for quality assurance purposes. If this product or material fails to perform in the accepted manner, the manufacturer will incur the expense of such testing and the AHJ may immediately revoke, modify, or suspend the use of such product or material within their jurisdiction. RER reserves the right to revoke this acceptance, if it is determined by Miami-Dade County Product Control Section that this product or material fails to meet the requirements of the applicable building code.

This product is approved as described herein, and has been designed to comply with the Florida Building Code including the High Velocity Hurricane Zone of the Florida Building Code.

DESCRIPTION: DMC 175S-.040" Aluminum Panel over Steel deck

LABELING: Each unit shall bear a permanent label with the manufacturer's name or logo, city, state and following statement: "Miami-Dade County Product Control Approved", unless otherwise noted herein.

RENEWAL of this NOA shall be considered after a renewal application has been filed and there has been no change in the applicable building code negatively affecting the performance of this product.

TERMINATION of this NOA will occur after the expiration date or if there has been a revision or change in the materials, use, and/or manufacture of the product or process. Misuse of this NOA as an endorsement of any product, for sales, advertising or any other purposes shall automatically terminate this NOA. Failure to comply with any section of this NOA shall be cause for termination and removal of NOA.

ADVERTISEMENT: The NOA number preceded by the words Miami-Dade County, Florida, and followed by the expiration date may be displayed in advertising literature. If any portion of the NOA is displayed, then it shall be done in its entirety.

INSPECTION: A copy of this entire NOA shall be provided to the user by the manufacturer or its distributors and shall be available for inspection at the job site at the request of the Building Official.

This NOA consists of pages 1 through 5.

The submitted documentation was reviewed by Gaspar J Rodriguez.



NOA No.: 15-1007.08
Expiration Date: 10/29/20
Approval Date: 10/29/15
Page 1 of 5

ROOFING SYSTEM APPROVAL:

Category: Roofing
Sub-Category: Metal, Panels (Non-Structural)
Material: Aluminum
Deck Type: Steel
Maximum Design Pressure -129.25 PSF

TRADE NAMES OF PRODUCTS MANUFACTURED OR LABELED BY APPLICANT:

| <u>Product</u> | <u>Dimensions</u> | <u>Test Specifications</u> | <u>Product Description</u> |
|--------------------------------|--|----------------------------|--|
| DMC 175S – .040 Aluminum Panel | Length: various Height: 1-5/8” Width: 17-1/2” Thickness .040” Min Yield Strength: 22 KSI | TAS 110 | Corrosion resistant, aluminum snap-lock panel. |
| Snap Lock Clip | Length: 3-3/4” Height: 1-7/8” Width: 2” Thickness 18GA | | Corrosion resistant, 18GA steel clip. |

EVIDENCE SUBMITTED:

| <u>Test Agency</u> | <u>Test Identifier</u> | <u>Test Name/Report</u> | <u>Date</u> |
|---------------------------------|------------------------|-------------------------|-------------|
| Akzo Nobel Coatings, Inc. | Lab Form | ASTM G 153 | |
| PRI Asphalt Technologies, Inc. | AKZC-001-02-01 | ASTM B 117 | 10/08/02 |
| | AKZC-001-02-02 | | |
| | AKZC-001-02-03 | | |
| | AKZC-001-02-04 | | |
| | AKZC-001-02-05 | | |
| PRI Asphalt Technologies, Inc. | HTL-013-02-01 | TAS 100 | 10/01/07 |
| Hurricane Test Laboratory, Inc. | 0287-0312-07 | TAS 125 | 08/16/07 |



NOA No.: 15-1007.08
Expiration Date: 10/29/20
Approval Date: 10/29/15
Page 2 of 5

APPROVED ASSEMBLIES:

| | |
|---------------------------------|--|
| System: | Snap Lock Panel .040" Aluminum 17-1/2" wide |
| Deck Type: | Steel, Non-insulated |
| Deck Description: | Metal roof deck 22 MSG grade A coated steel. Panel continuous over two or more spans without end laps. |
| Slope Range: | 2": 12" or greater |
| Maximum Uplift Pressure: | See Table A below |

| | |
|--------------------------------------|---|
| Deck Attachment: | Minimum 22 GA steel deck shall be secured 6" on center to structural supports spaced a maximum of 5 feet on center with <u>one (1)</u> #12 x 1-1/2" Hex Washer Head self drilling screws fastened at the bottom of each flute (6" on center). Deck side laps shall be fastened 6" on center with #12 x 1-1/2" Hex Head self drilling screws. |
| Underlayment: | Minimum underlayment shall be an ASTM D 226 Type II installed with a minimum 4" side-lap and 6" end-laps. Underlayment shall be fastened with corrosion resistant tin-caps and #10 pancake head screws long enough to penetrate the deck, spaced 6" on center at all laps and two staggered rows 6" on center in the field of the roll or any approved underlayment having a current NOA. |
| Fire Barrier Board: | Any approved fire barrier having a current NOA. Refer to a current fire directory listing for fire ratings of this roofing system assembly as well as the location of the fire barrier within the assembly. See Limitation # 1. |
| Valleys: | Valley construction shall be in compliance with Roofing Application Standard RAS 133 and with the current published installation instructions and details in DMC Association of Regional Manufacturers Installation Manual. |
| Metal Panels and Accessories: | Install the "DMC 175S-.040" Aluminum Panel" including flashing penetrations, valleys, end laps and accessories in compliance with "DMC Association of Regional Manufacturers" current published installation instructions and in compliance with the minimum requirements detailed in Roofing Application Standard RAS 133. |
| Fastening: | Panels shall be secured along the male rib with approved clips and two corrosion resistant #10 pancake head fasteners of sufficient length to penetrate through the sheathing a minimum of 3/16". The panel clips shall be placed at a spacing listed in Table A below starting 3" from panel end. The female rib of panel is snapped over the male rib of panel. |

| TABLE A MAXIMUM DESIGN PRESSURES | | |
|-------------------------------------|---------|-----------------------------------|
| Roof Areas | Field | Perimeter and Corner ¹ |
| Maximum Design Pressures | -88 PSF | -129.25PSF |
| Maximum Clip Spacing | 18" OC | 12" OC |

1. Extrapolation shall not be allowed

LIMITATIONS


1. Fire classification is not part of this acceptance; refer to a current Approved Roofing Materials Directory for fire ratings of this product.
2. The maximum designed pressure listed herein shall be applicable to all roof pressure zones (i.e. field, perimeters, and corners). Neither rational analysis, nor extrapolation shall be permitted for enhanced fastening at enhanced pressure zones (i.e. perimeters, extended corners and corners).
3. Panels may be rolls formed in continuous lengths from eave to ridge. Maximum lengths shall be as described in Roofing Application Standard RAS 133
4. All panels shall be permanently labeled with the manufacturer's name and/or logo, city and state, and the following statement: "Miami-Dade County Product Control Approved" **or** with the Miami-Dade County Product Control Seal as seen below. All clips shall be permanently labeled with the manufacturer's name and/or logo, and/or model.




5. All products listed herein shall have a quality assurance audit in accordance with the Florida Building Code and Rule 61G20-3 of the Florida Administrative Code.
6. Panels may be jobsite roll formed with machine model #SSQ4750915 from DMC Association of Regional Manufacturers.




PROFILE DRAWINGS

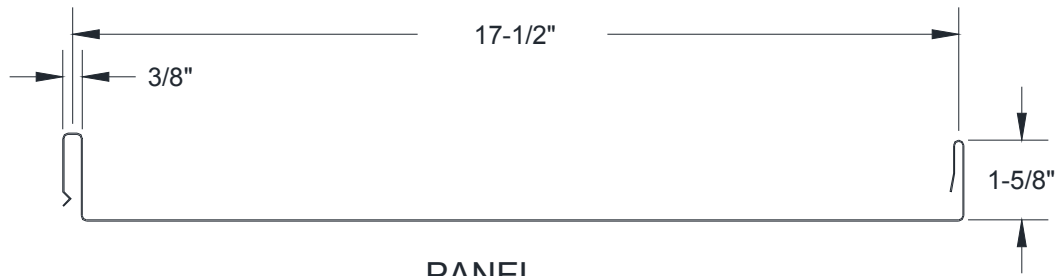

PANEL

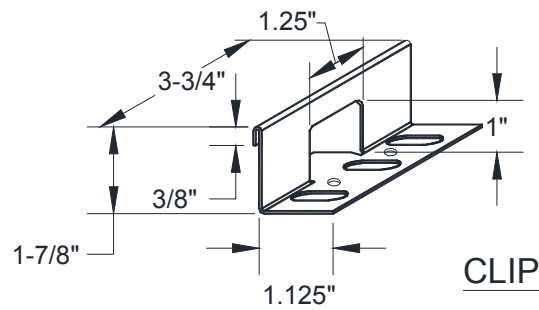

CLIP

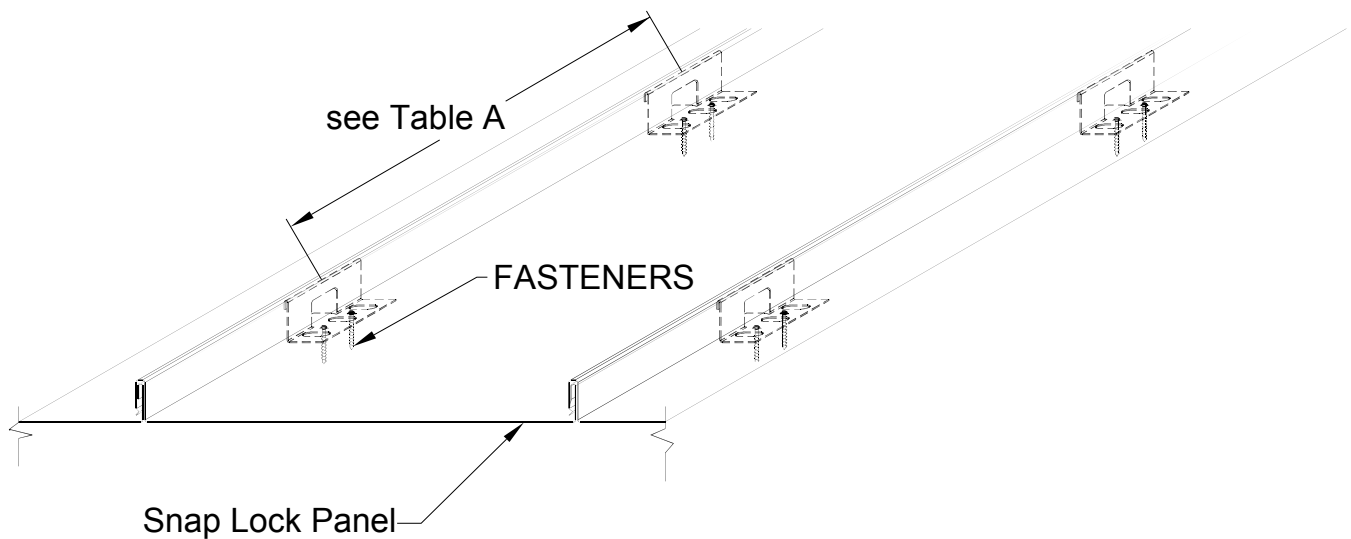

END OF THIS ACCEPTANCE